

MUCH LOWER CO_2 EMISSIONS WITH EXHAUST GAS HEAT RECOVERY

MODULAR EXHAUST GAS HEAT EXCHANGERS

⊕ YOUR CONTRIBUTION TO FUTURE GENERATIONS

**Wellness
& spas**



bomat[®]
MAKING MORE OF ENERGY

MORE
SAVINGS.
GREATER
EFFICIENCY.

MAKES MORE
OF ENERGY.



ENERGY CONSUMPTION
WITH

GAS -15 %*

For gas fired heat generators, the use of BOMAT exhaust gas heat exchangers can lower energy consumption by up to 15 %.



ENERGY CONSUMPTION
WITH

OIL -10 %*

The use of BOMAT exhaust gas heat exchangers can lower energy consumption by up to 10 %. The heat is recovered from the hot exhaust gas, and condensing technology is used to harness the condensation energy of the water vapour contained in this gas.



EMISSION OF
ACIDS
-60 %*

During combustion, sulphur and sulphur compounds contained in the respective fuel react with atmospheric oxygen and the water vapour in the exhaust gas to form sulphuric acid (acid rain). This acidic exhaust gas condenses in BOMAT heat exchangers.



EMISSION OF
CO₂ -15 %*

Less CO₂ is emitted due to energy conservation. The greater the energy saving, the higher the CO₂ reduction.

*Compared to conventional heat generators.

BOMAT HEAT EXCHANGERS.

REAP THE BENEFITS OF EFFICIENT SOLUTIONS FROM THE MARKET LEADER.

Aim: minimise environmental impact

Many fuels contain acidifying agents (such as sulphur) that form an aggressive, vaporous acid/water mixture during combustion. In the case of conventional heat generators, these combustion acids contained in the exhaust gas pass through a chimney and are blown into the environment. They then condense and enter the soil through precipitation (acid rain), where they can harm flora and fauna. Even buildings can suffer damaging effects.

Solution: BOMAT for the perfect harmony of ecology...

The high performance plastic pipes used in BOMAT heat exchangers are characterised by excellent thermal conductivity and an extremely long service life. They are also resistant to acids and alkalis.

...and economy


Condensing technology cools the exhaust gas in the heat exchangers until it condenses. Heat is released and transferred to the heating water. Fuel consumption and running costs are significantly reduced.

Less in, more out

Now with even better energy utilisation, BOMAT is at the cutting edge of advanced heating technology. Ensuring investments pay off in just a few years.

SIMPLY BETTER: THE BOMAT PROFITHERM SERIES

BOMAT exhaust gas heat exchangers cool hot exhaust gases to below the dew point. The thermal energy and condensation heat in the exhaust gas are recovered and transferred to the water heating circuit. Condensing technology with non-corrosive heat exchangers from BOMAT.

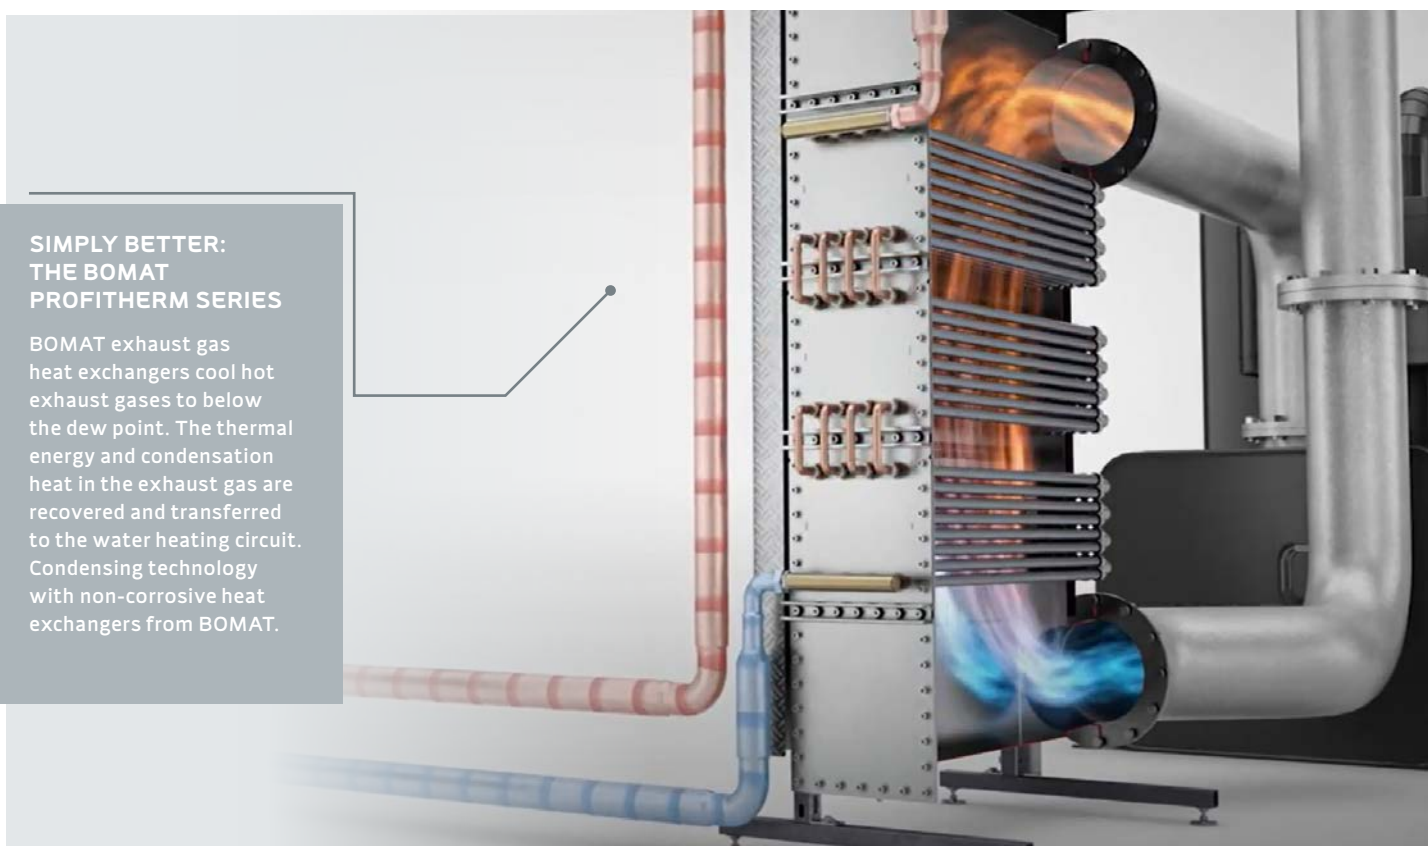



TECHNOLOGY 4.0

HERE'S HOW OUR HEAT EXCHANGERS WORK.



Heat is transferred indirectly from the hot exhaust gases

The hot exhaust gases flow through the heat exchanger and heat liquids in pipes with high thermal conductivity.

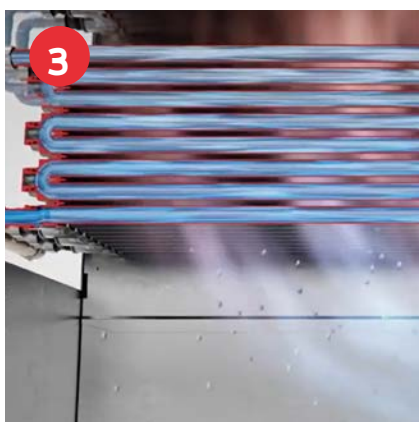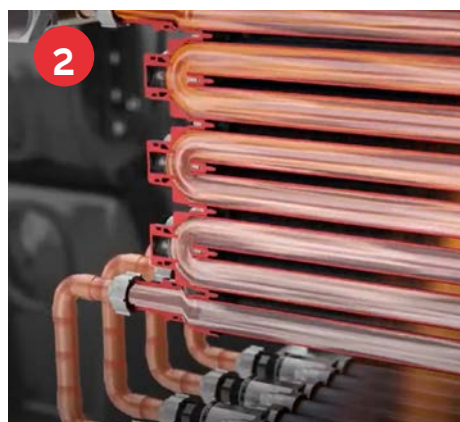


Heat is extracted from the exhaust gases

In the first stage of the process, most of the heat is extracted from the exhaust gas.

Residual heat is removed

Then the residual heat is removed from the exhaust gas through a process of condensation.

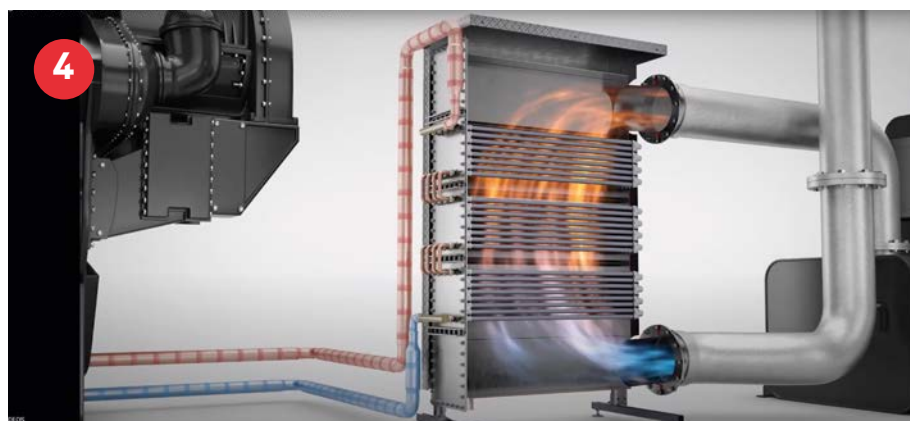

Calorific value effect: maximum energy yield

The thermal energy obtained can be utilised in many ways and leads to significantly reduced CO₂ emissions. For example, it can be used to heat process air or rooms, or be fed into a district heating grid.

HIGHLIGHTS

EASILY ADJUSTABLE OUTPUT THANKS TO CASCADABLE INSTALLATION.

Suitable for operation with fuel oil, natural gas, biogas, sewage gas and landfill gas

Up- and downsizing: exactly as you require

**HIGH PERFORMANCE PLASTIC,
STAINLESS STEEL
OR CERAMICS^{*)}**

***) Pipe sections individually selectable**


Low pressure drop on the exhaust gas side and fully corrosion-resistant

Easy to clean due to slide-in heater bank



TECHNICAL DATA

FOOTPRINT AND CONNECTION DIMENSIONS.

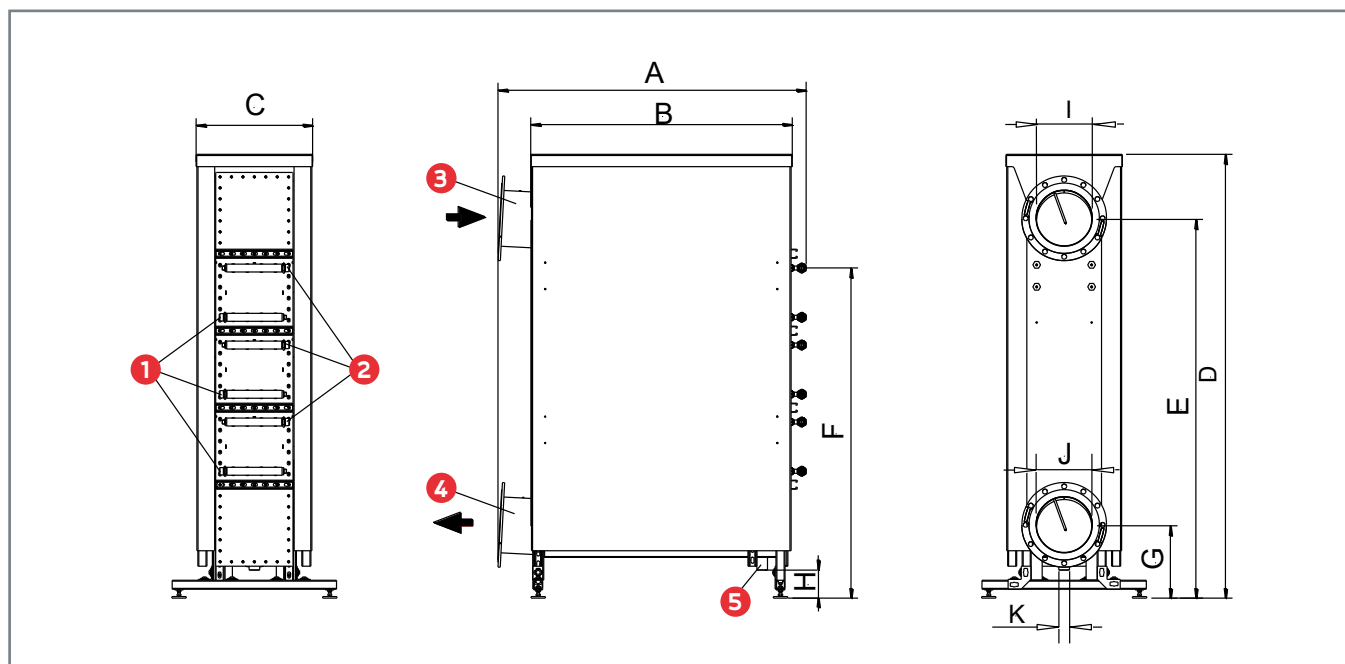

Key

- 1 Water inlet, internal thread, R1 (DN 25)
- 2 Water outlet, internal thread, R1 (DN 25)
- 3 Exhaust gas inlet (DN 250) ***)
- 4 Exhaust gas outlet (DN 250) ***)
- 5 Condensate outlet

Temperatures and pressures

Max. permissible exhaust gas outlet temperature	120 °C
Max. permissible operating pressure	3/6 bar
Max. permissible exhaust gas inlet temperature	400 °C
Max. permissible water outlet temperature	95 °C
Max. permissible heating gas overpressure	5000 Pa

Profitherm Modular EGHE →		03-KK-1064-MT-4-9-6 (03M1064)
Water capacity	litres	53.6
Weight	kg	approx. 300 **)
Water connections		
Dimensions (mm)		
	A	1375
	B	1190
	C	542
	D *)	2018
	E *)	1715
	F *)	1490
	G *)	325
	H *)	115
	I+J	250
	K	DN 50

*) Infinitely adjustable by +/-10 mm via machine levelling foot

**) Depending on the design

***) In accordance with DIN 2642 type B

Maximum permissible exhaust gas sound pressure 70 dB(A). On-site measures required for higher sound pressure. Subject to technical changes.

SHORT PAYBACK PERIODS


YOUR COST SAVINGS.



3 EXAMPLES OF CALCULATIONS:

PAYBACK PERIODS
AND CO₂ REDUCTIONS
FOR CHP UNITS IN THE
WELLNESS & SPA SEGMENT

	Exhaust gases from Buderus 720 kW gas boiler for a swimming pool	Exhaust gases from MOVE 250 kWel CHP unit for a leisure pool	Exhaust gases from Bosch 140 kWel CHP unit for a leisure pool
Fuel	Natural gas	Natural gas	Natural gas
No. of BOMAT exhaust gas heat exchangers (EGHE):	1	1	1
Exhaust gas quantity	1160 kg/h	1050 kg/h	580 kg/h
Exhaust gas inlet temperature into the BOMAT EGHE:	175 °C	120 °C	110 °C
Exhaust gas outlet temperature from the BOMAT EGHE:	60 °C	55 °C	50 °C
Water inlet temperature into the BOMAT EGHE:	40 °C	40 °C	30 °C
Water outlet temperature from the BOMAT EGHE:	45 °C	44 °C	35 °C
Heat recovery capacity:	39 kW	25 kW	18 kW
Cost of BOMAT EGHE(s) and accessories:	€18,000	€18,500	€13,600
Cost of installation, pipework and accessories (estimated):	€17,000	€16,000	€12,000
Total investment (estimated):	€35,000	€34,500	€25,600
Unit runtime:	4000 h	8000 h	6500 h
Heat recovery per year	156,000 kWh	200,000 kWh	117,000 kWh
Heat price (estimated)	€0.08	€0.06	€0.07
Payback period, approx.	2.8 years	2.9 years	3.1 years
CO₂ reduction per year, approx.	31,356 kg	40,200 kg	23,517 kg

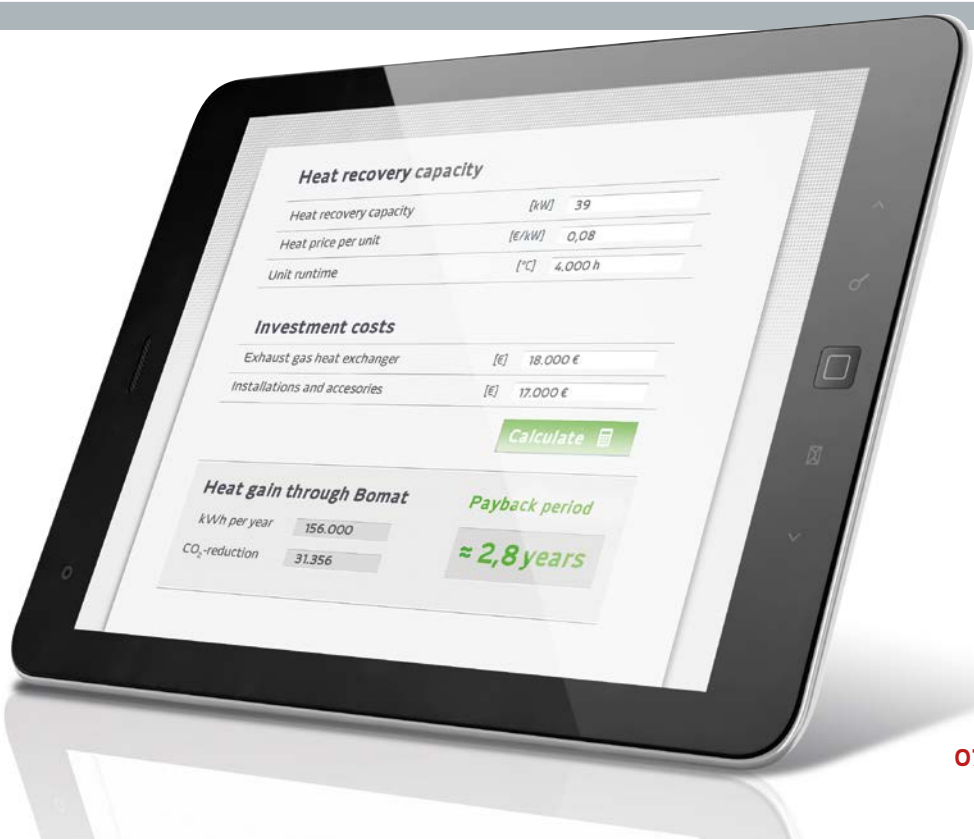

STATE FUNDING

THERE ARE GENERALLY STATE SUBSIDIES AVAILABLE FOR YOUR INVESTMENT.

Information on funding

Generally speaking, **BOMAT exhaust gas heat exchangers are eligible for subsidies** and practically all of our customers take advantage of these. There are various funding programmes depending on the application and federal state, offering a one-off subsidy or inexpensive loan according to the programme and institution. A number of CO₂ reduction and energy saving

programmes are currently available.

The **Federal Funding Programme for Energy and Resource Efficiency in the Economy** (*Bundesförderung für Energie- und Ressourceneffizienz in der Wirtschaft*) is particularly noteworthy. There is always something suitable, whether you are a small enterprise or company group.



Aim of funding

Funding is available for the use of climate protection technology in commercial applications, to name one example. The aim is to reduce greenhouse gas emissions.

Talk to our **energy consultants**, we'd be happy to help you with this.

ENERGY CONSULTING

HELP REDUCE CO₂ EMISSIONS AND
ASK OUR ENERGY CONSULTANTS ABOUT
THE RIGHT SOLUTION FOR YOU.

Professional advice and support

Our skilled and experienced energy consultants are there for you. Whether you need help applying for subsidies or professional support on construction matters, it is important to have somebody who knows what they are doing by your side. Involving a professional energy

consultant can greatly simplify many projects, given the often complex guidelines that must be met in order to obtain subsidies. BOMAT energy consultants actively and expertly support you and your project.



REFERENCES. WELLNESS & SPAS



HEIDE SPA HOTEL & RESORT

Kurbetriebsgesellschaft Dübener Heide mbH,
Bitterfelder Str. 42, 04849 Bad Dübener Heide

Heat generator: Omnimat 16.1 PGA 125

Exhaust gas heat exchanger: O6-GG-1046-NT-4-K-3

Exhaust gas temperature: approx. 25 °C
(into heat exchanger)
approx. 35 °C
(from heat exchanger)

Heat recovery
per year: approx. 220,000 kWh

CO₂ reduction per year: approx. 44,000 kg

➔ Payback period of **less than 5 years.**



RIFF SPA AND LEISURE POOL

BBK Bad Lausicker Bauorganisations-, Betriebs- und
Kur GmbH, Am Riff 3, 04651 Bad Lausick

Heat generator: Omnimat 16 PGA 260

Exhaust gas heat exchanger: O5-GG-1046-NT-4-K-3

Exhaust gas temperature: approx. 95 °C
(into heat exchanger)
approx. 60 °C
(from heat exchanger)

Heat recovery
per year: approx. 150,000 kWh

CO₂ reduction per year: approx. 30,000 kg

➔ Payback period of **less than 5 years.**



BADRIA SWIMMING POOL, SPORTS AND LEISURE CENTRE

Stadtwerke Wasserburg a. Inn, Alkorstrasse 14
83512 Wasserburg am Inn

Heat generator:	2 x Move MP 250 CHP unit
Exhaust gas heat exchanger:	2 x Hereus ME 250 (O2-GG-1032-MT-4-9-3)
Exhaust gas temperature:	approx. 120 °C (into heat exchanger) approx. 65 °C (from heat exchanger)
Heat recovery per year:	approx. 420,000 kWh (for both CHP units)
CO₂ reduction per year:	approx. 84,000 kg (for both CHP units)

➔ Payback period of **less than 3 years.**




BOSCH THERMOTECHNIK GMBH

Geibeltbad Pirna, Rottwerndorfer Str. 56 C
01796 Pirna

Heat generator:	Buderus Loganova EN 140
Exhaust gas heat exchanger:	O3-GG-1032-MT-4-9-3
Exhaust gas temperature:	approx. 110 °C (into heat exchanger) approx. 55 °C (from heat exchanger)
Heat recovery per year:	approx. 360,000 kWh
CO₂ reduction per year:	approx. 72,000 kg

➔ Payback period of **less than 3 years.**

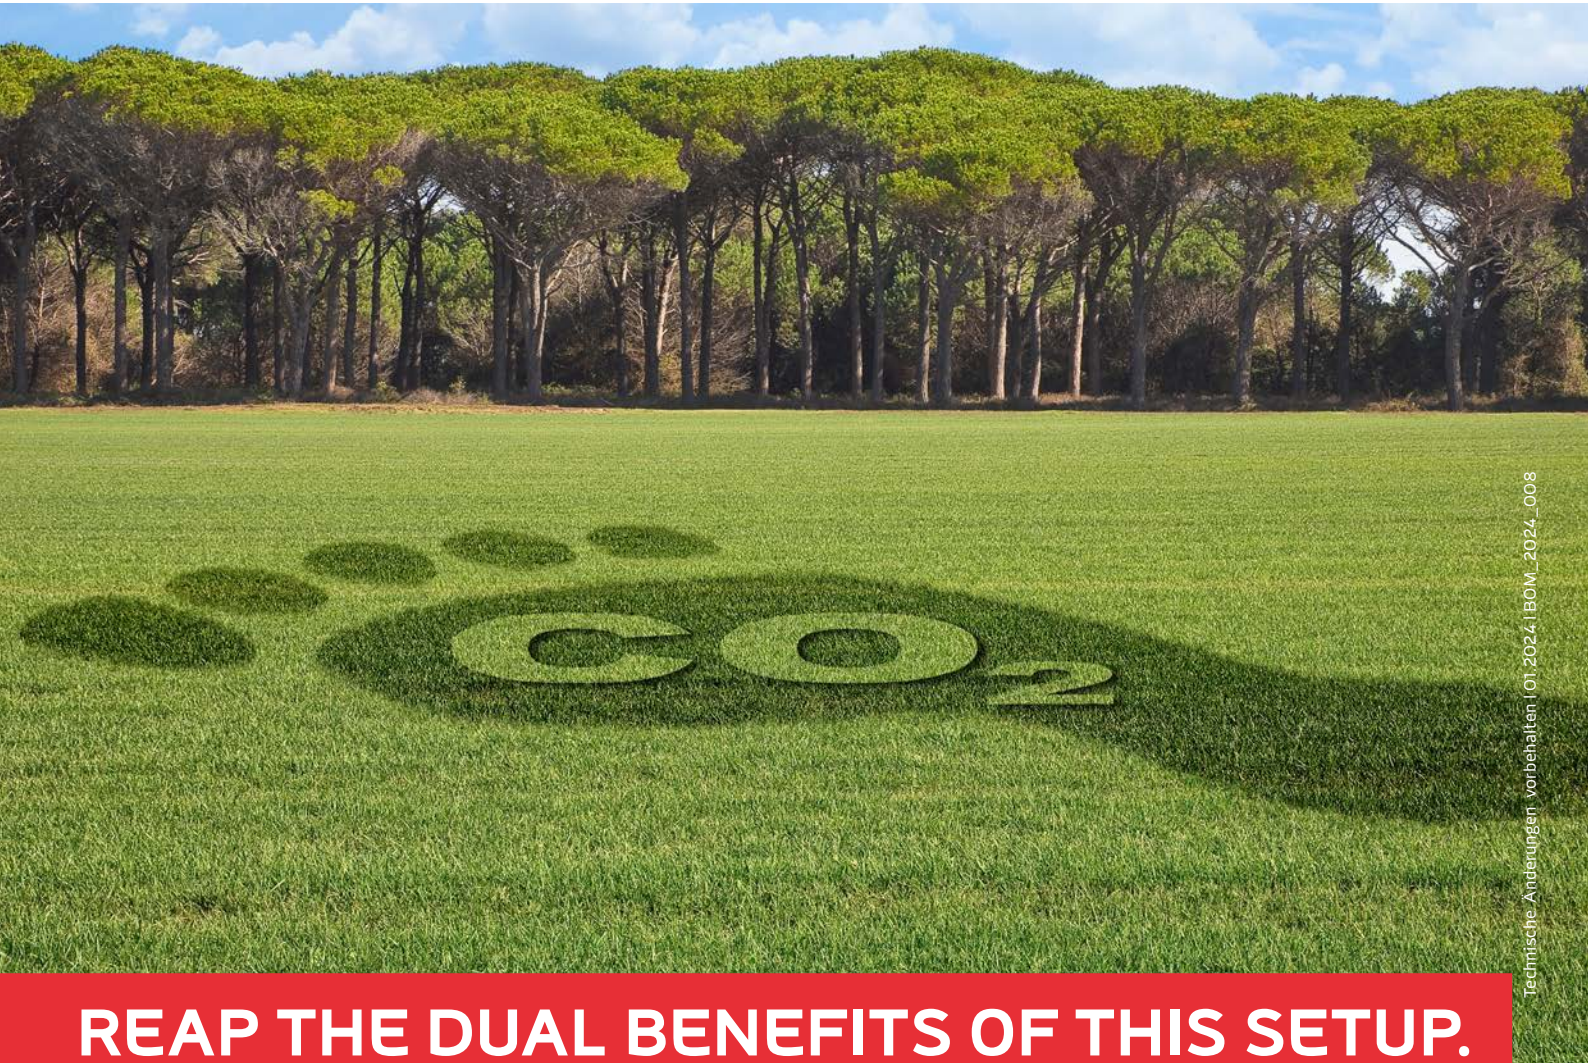

Technische Änderungen vorbehalten | 01.2024 | BOM. 2024_008

REAP THE DUAL BENEFITS OF THIS SETUP.

ARRANGE A NO-OBLIGATION
CONSULTATION WITH
US NOW.



BOMAT Energiesysteme GmbH
Zum Degenhardt 49

88662 Überlingen
Germany

P +49 (0) 75 51.80 99 70
F +49 (0) 75 51.80 99 71

info@bomat.de
www.bomat.de

